


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED


CONSTRUCTION:

- FILTER MODULE TO BE CONSTRUCTED OF 14 GA. ANODIZED ALUMINUM
- FRAME TO BE CONSTRUCTED OF 1 1/2 X 1 1/2 X 16 GA. TUBULAR TYPE 304 SS
- UNIT TO MEET ISO 14644-1 FOR CLASS 5
- ELECTRICAL WIRING TO CONFORM LATEST NEC STANDARDS
- CUSTOMER TO PROVIDE 115 VOLT/ 60HZ/ 15A SERVICE TO UNIT

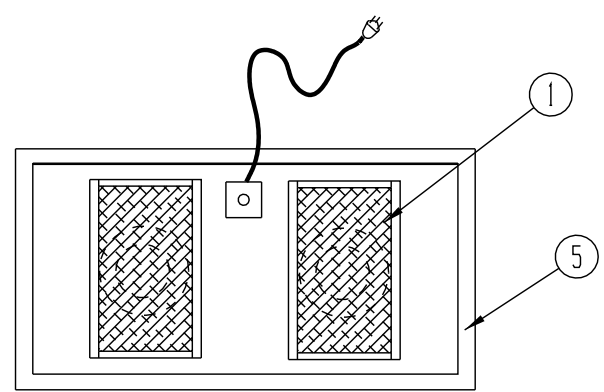


TOP VIEW

- ① 1 EA. FTE2448-LD/AA/PF FAN FILTER MODULE WITH PRE-FILTERED INTAKES, ELECTRONIC SPEED CONTROL AND 99.99% EFFICIENT HEPA FILTER.
- ② CONTROL PANEL WITH BLOWER SWITCH, LIGHT SWITCH AND MINIHELIC PRESSURE GAUGE
- ③ 1 EA. 4 FT SS TEARDROP LIGHT FIXTURE
- ④ 8' LONG 115V POWER CORD
- ⑤ 1 1/2" TUBULAR STAINLESS STEEL FRAME
- ⑥ 20 GA. SS REAR PANEL
- ⑦ 20 GA SS SIDE PANELS

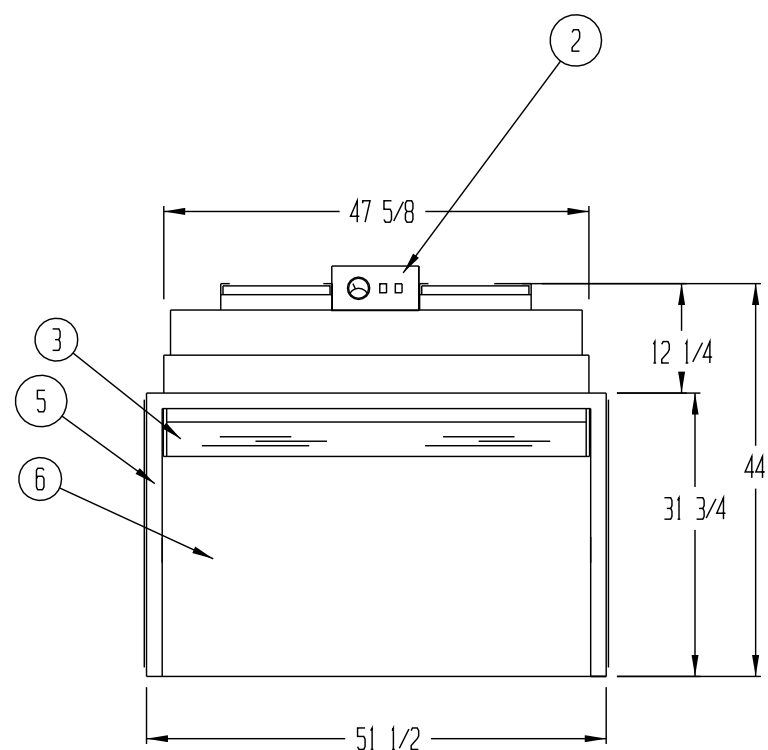

FRONT VIEW

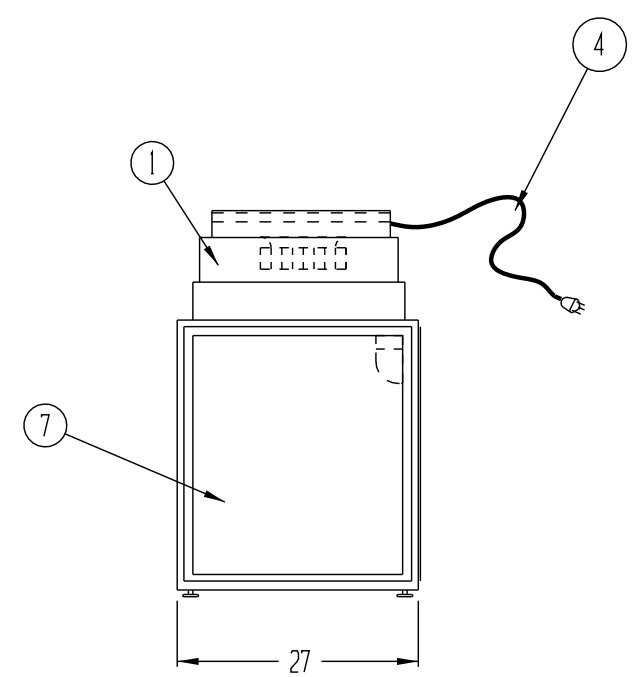

RIGHT SIDE VIEW

DRAWN FOR		<b>HALCO PRODUCTS CO.</b> 100 NO. GORDON STREET ELK GROVE, IL. 60007			
		TITLE ECAT4302-SFE/TT			
DRAWN BY	TM	SIZE	JOB NO. -----	DWG NO.	1915331BHalco
APPROVED BY		SCALE	1/2" = 1'- 0"	DATE	10-8-08
				SHEET	